


# CLASS PACK WIRING DIAGRAM - OCCUPANCY SENSING ONLY

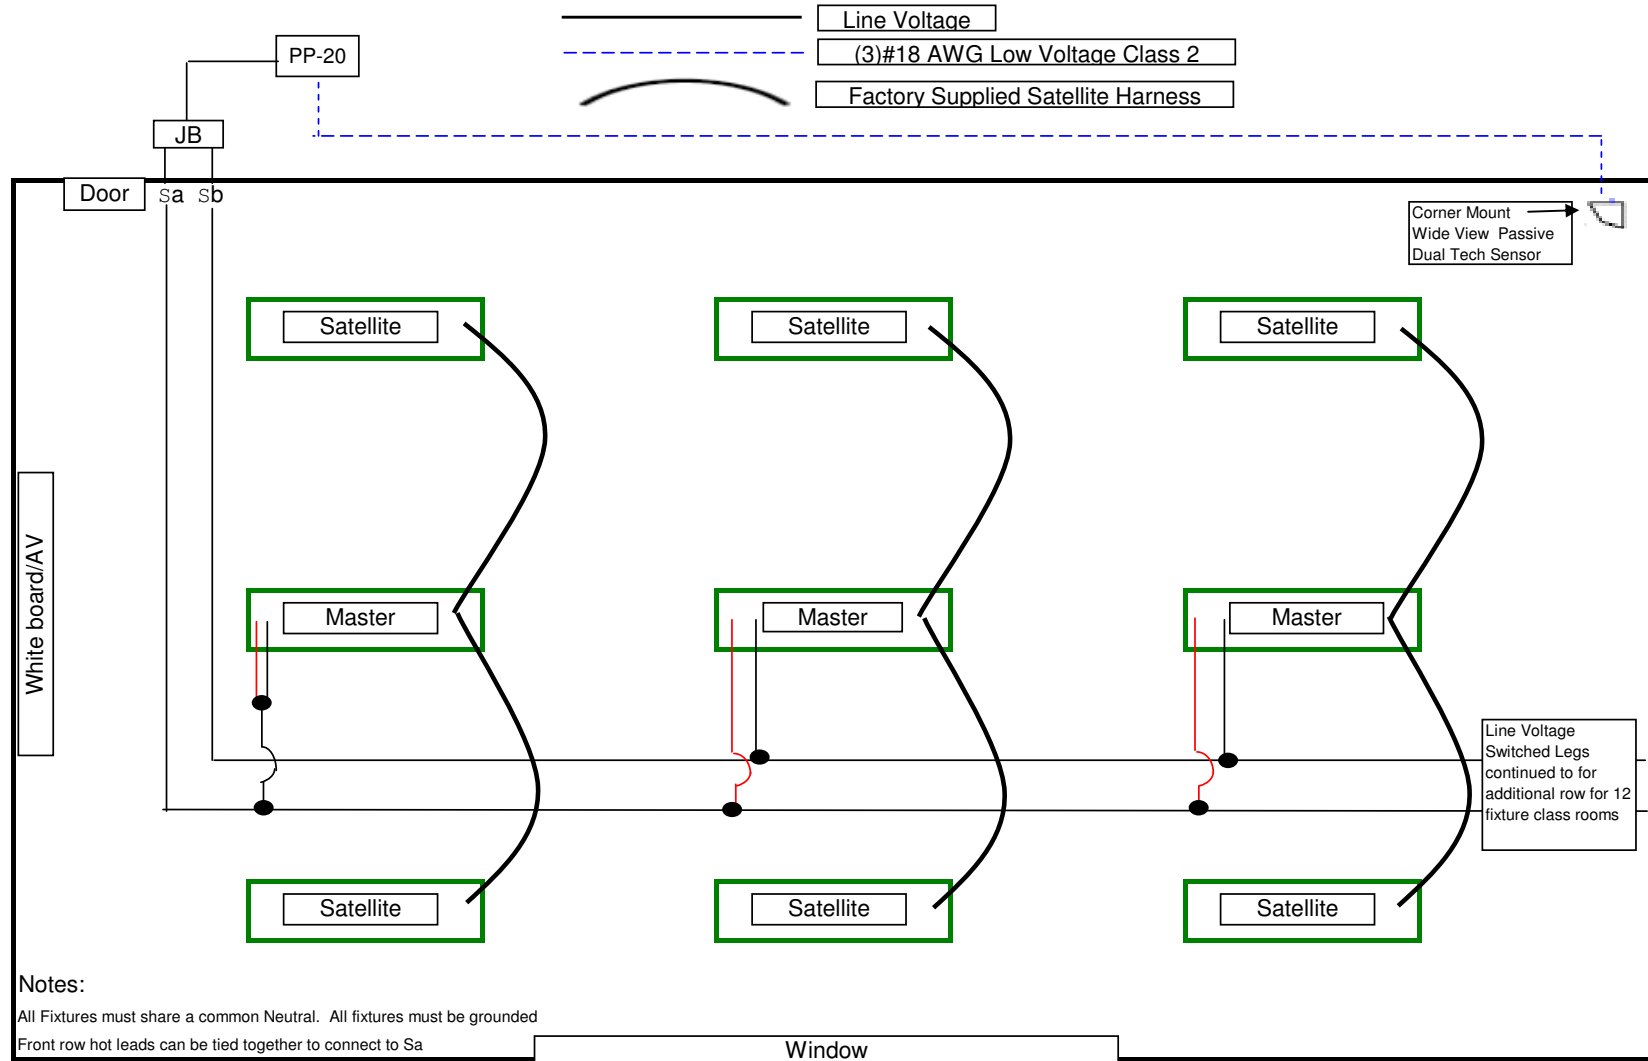

## Controls Bill of Material

- 1 - WV-PDT (OCCUPANCY SENSOR)
- 1 - PP-20 (POWER PACK)

## Occupancy Sensor Sequence of Operation

THE ROOM IS CONTROLLED VIA THE OCCUPANCY SENSOR MOUNTED IN THE CORNER. 2 STANDARD TOGGLE SWITCHES LOCATED AT THE DOOR ALLOW THE LIGHTS TO BE FORCED OFF AS NEEDED MANUALLY. THE OCCUPANCY SENSOR PROVIDES AUTOMATIC OFF

USING OPTIONAL SWEEP SWITCHES INSTEAD OF STANDARD TOGGLE SWITCHES PROVIDES MANUAL ON/AUTO OFF OPERATION EVERY TIME THE SENSOR TURNS OFF THE LIGHTS WHILE STILL ALLOWING THE SWITCHES TO FORCE THE LIGHTS OFF AS NEEDED FOR PRESENTATIONS

## Ballast Wiring

